

UTILITY COMPANY: Alliant Energy

CONTACT INFO: South-Central Wisconsin

Primary Conduit Rules: Direct bury or customer specification


Secondary Conduit Rules: Install conduit over 200A, 200A direct bury or customer specifies we install conduit

Riser Rules: Stub up at pole. Alliant installs U-Guard on pole. Check with inspector if rigid above grade is required.

Wire Rules: Alliant will pull wire from transformer to meter equipment

Pad-Mount Transformers: Verify interrupt rating of breakers with local inspector. Many Alliant transformers require 65,000 interrupt ratings which require special breakers or fused disconnects.

Meter Socket: Lever bypass. At least a 4 gang is needed for cell towers
 Must label positions of meter sockets of multi-meter banks and notify inspector and WE Energies

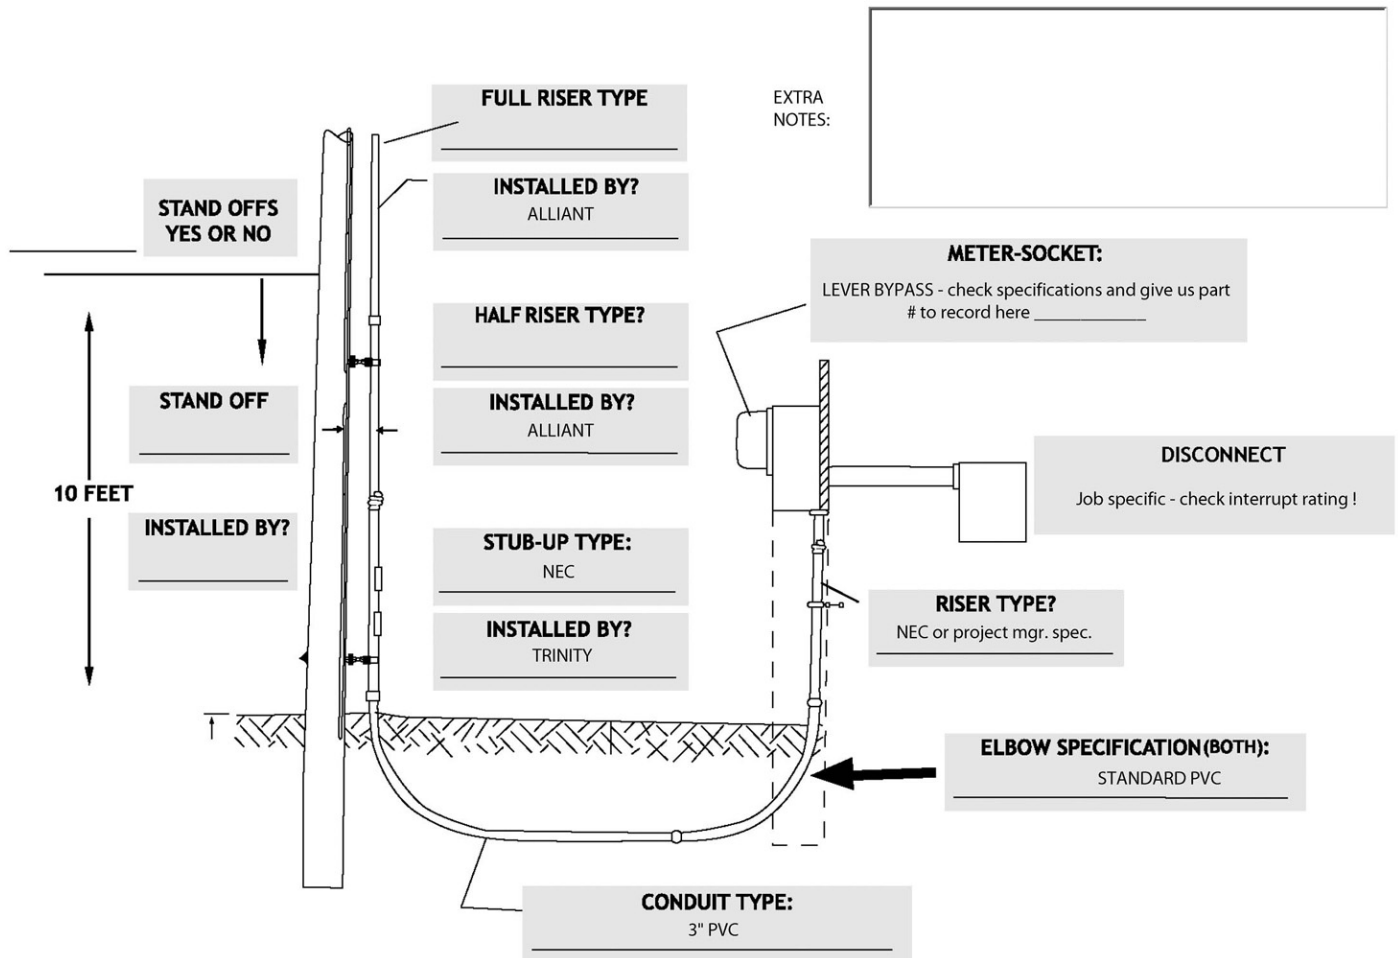

TRINITY TECHNOLOGIES LLC - 4602 PFLAUM ROAD - MADISON, WI 53718 - (608) 221-2333