

UTILITY COMPANY: Exelon Corp/Commonwealth Edison

CONSTRUCTION DEPT: (866) 639-3532

CONTACT INFO: CITY OF CHICAGO - DAVE LISKA: (773) 509-3417 SHANNON WALTON: (630) 437-2064

TOM SIDNEY: (773) 908-5340 VALERIE: (815) 724-5056

Primary Conduit Rules: Install per project manager specifications


Secondary Conduit Rules: COMED doesn't require rigid above grade, but inspectors and customers do (especially in Chicago)

Riser Rules: Install 10 foot rigid riser on COMED poles. Install a full riser on PRIVATE poles.

Wire Rules: We pull all wire from meter socket to transformer. Double check length to minimize waste.

Pad-Mount Transformers: Need to schedule watchman ASAP. Hard to get them out to open up transformer. Also need to verify stub-up location at transformer. Verify if we have to pull wire into transformer or not. Will the wire get stolen in this location if we pull it in too soon? It is typically okay to bury wire at transformer.

Meter Socket: Horn bypass CECHA meter socket. Meter jumper OKAY. Meter pedestals are preferred (NU8980-u/g and U7607-o/h). CHECK FOR 120/208 SERVICE REQUIRING 5TH JAW INSTALLATION. Both pedestals have different 5th jaw parts.

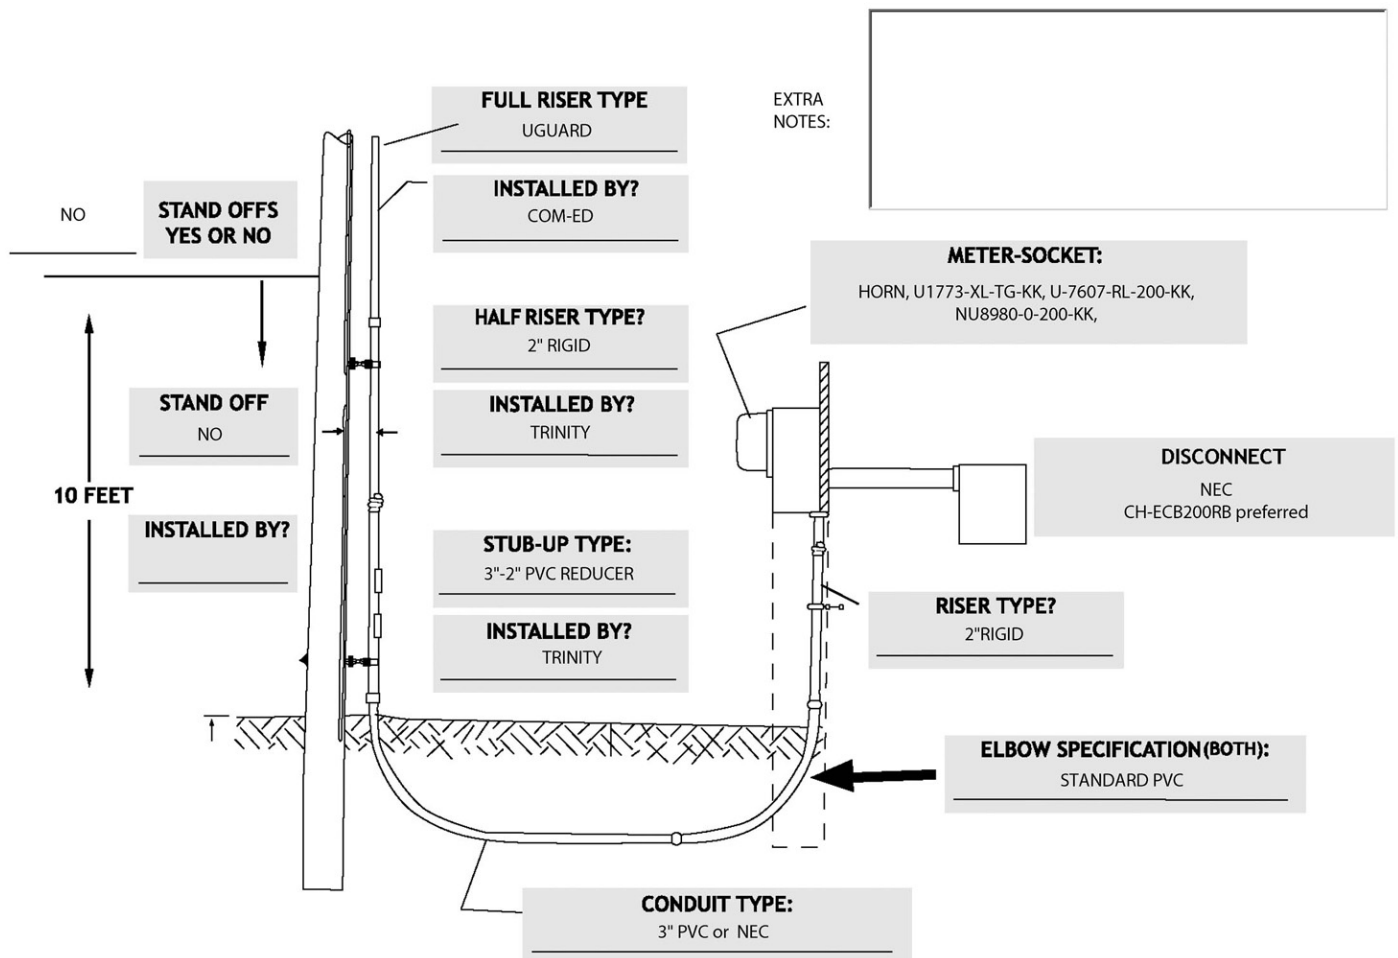

TRINITY TECHNOLOGIES LLC - 4602 PFLAUM ROAD - MADISON, WI 53718 - (608) 221-2333