

UTILITY COMPANY: NIPSCO

CONTACT INFO: Northwest Indiana (888) 689-8665 Alexis ext. - #9835 - T-Mobile Constance - ext. #9838 - Nextel/Sprint

Mike 219-477-3268 574-935-8176 or 8192 or 8109

Primary Conduit Rules: we install 3" PVC conduit for NIPSCO's primary wire


Secondary Conduit Rules: NIPSCO doesn't require rigid above grade BUT USCC, Cingular, T-Mobile requires rigid above grade.

Riser Rules: Stub up next to NIPSCO's pole. Run riser & weatherhead up PRIVATE poles (2" okay).

Wire Rules: NIPSCO pulls wire for 100-200 amp service. We pull wire for 400A and over.

Pad-Mount Transformers: They connect pad-mount transformers & J-boxes. Call watch man if need access ASAP

Meter Socket: Horn bypass meter socket. NO METER JUMPERS. NIPSCO needs to know multi-meter position #s & they must be labeled - make sure to tell inspector also. Meter pedestals are okay (NU8980-u/g and U7607-o/h). Multi-meter banks only need to be HORN bypass because each position is its own service - Scott argues NOT Lever Bypass.

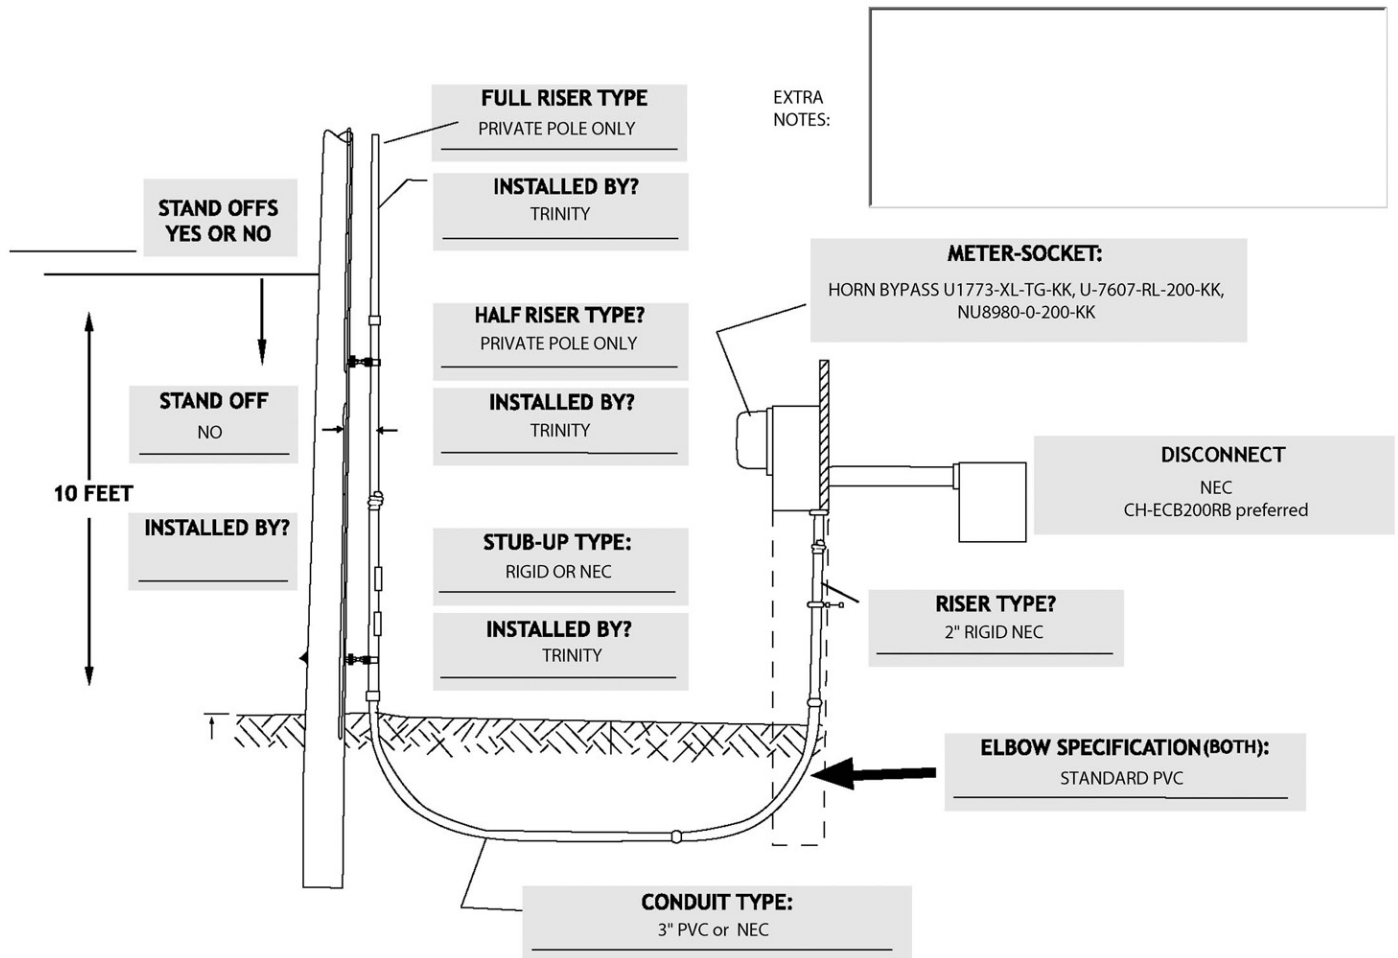

TRINITY TECHNOLOGIES LLC - 4602 PFLAUM ROAD - MADISON, WI 53718 - (608) 221-2333